


GROUND ELEV. = 865.0 ±
 MAX. STATIC PRESS. = 127.7 PSI ±
 REDUCED PRESS. 67.7 PSI±


GROUND ELEV. = 878.0 ±
 MAX. STATIC PRESS. = 122.1 PSI ±
 REDUCED PRESS. 62.1 PSI±

GROUND ELEV. = 870.0 ±
 MAX. STATIC PRESS. = 125.5 PSI ±
 REDUCED PRESS. 65.5 PSI±

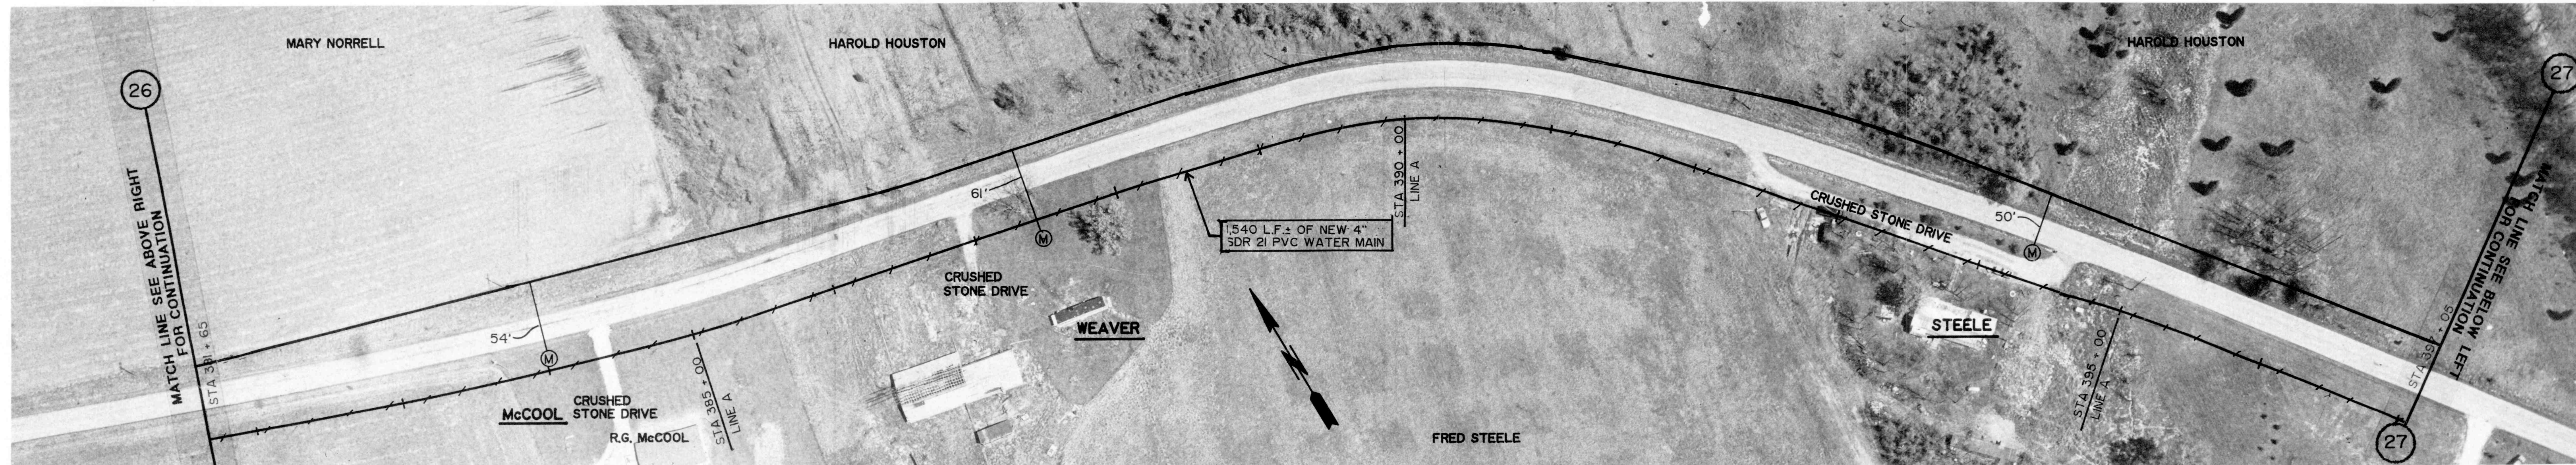

GROUND ELEV. = 870.0 ±
 MAX. STATIC PRESS. = 125.5 PSI ±
 REDUCED PRESS. 65.5 PSI±

GROUND ELEV. = 855.0 ±
 MAX. STATIC PRESS. = 132.0 PSI ±
 REDUCED PRESS. 72.0 PSI±

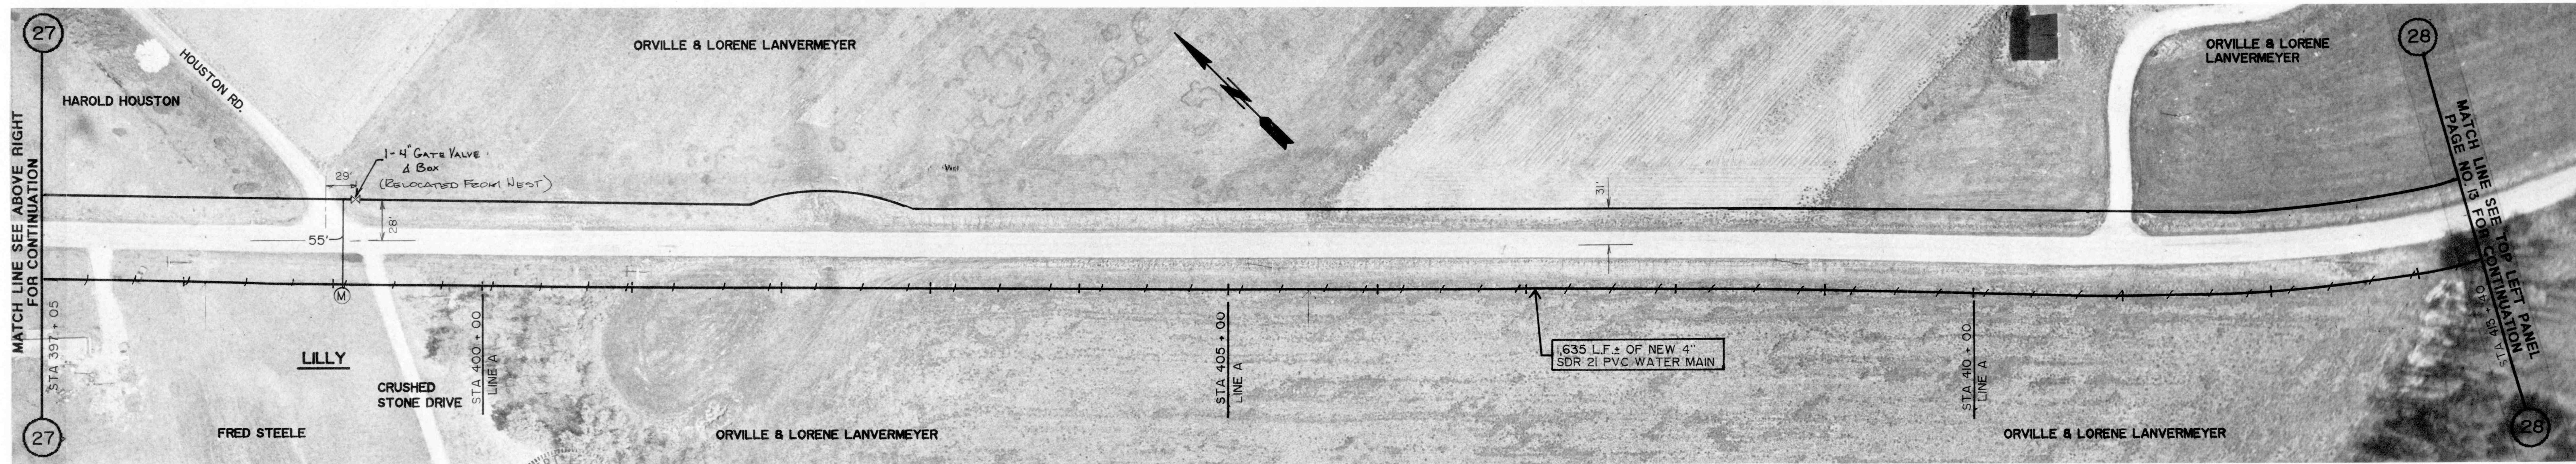

GROUND ELEV. = 855.0 ±
 MAX. STATIC PRESS. = 132.0 PSI ±
 REDUCED PRESS. 72.0 PSI±

GROUND ELEV. = 860.0 ±
 MAX. STATIC PRESS. = 129.9 PSI ±
 REDUCED PRESS. 69.9 PSI±

REVISIONS	DRAWN BY	RL	ROBERT E. CURRY & ASSOCIATES, INC. CONSULTING ENGINEERS	ELROD WATER COMPANY INC. DIVISION "D" DISTRIBUTION SYSTEM EXTENSIONS	4" PVC WATER MAIN EXTENSION ALONG CHESTERVILLE ROAD	JOB NO.	SHT. 12
	DATE	10/1/91				SCALE 1" = 50'	OF 43
	CERTIFIED BY	REC					
	DATE	12/1/91					