


GROUND ELEV. = 993.0 ±
MAX. STATIC PRESS. = 72.3 PSI ±

WEST COUNTY LINE ROAD


GROUND ELEV. = 1000.0 ±
MAX. STATIC PRESS. = 69.3 PSI ±

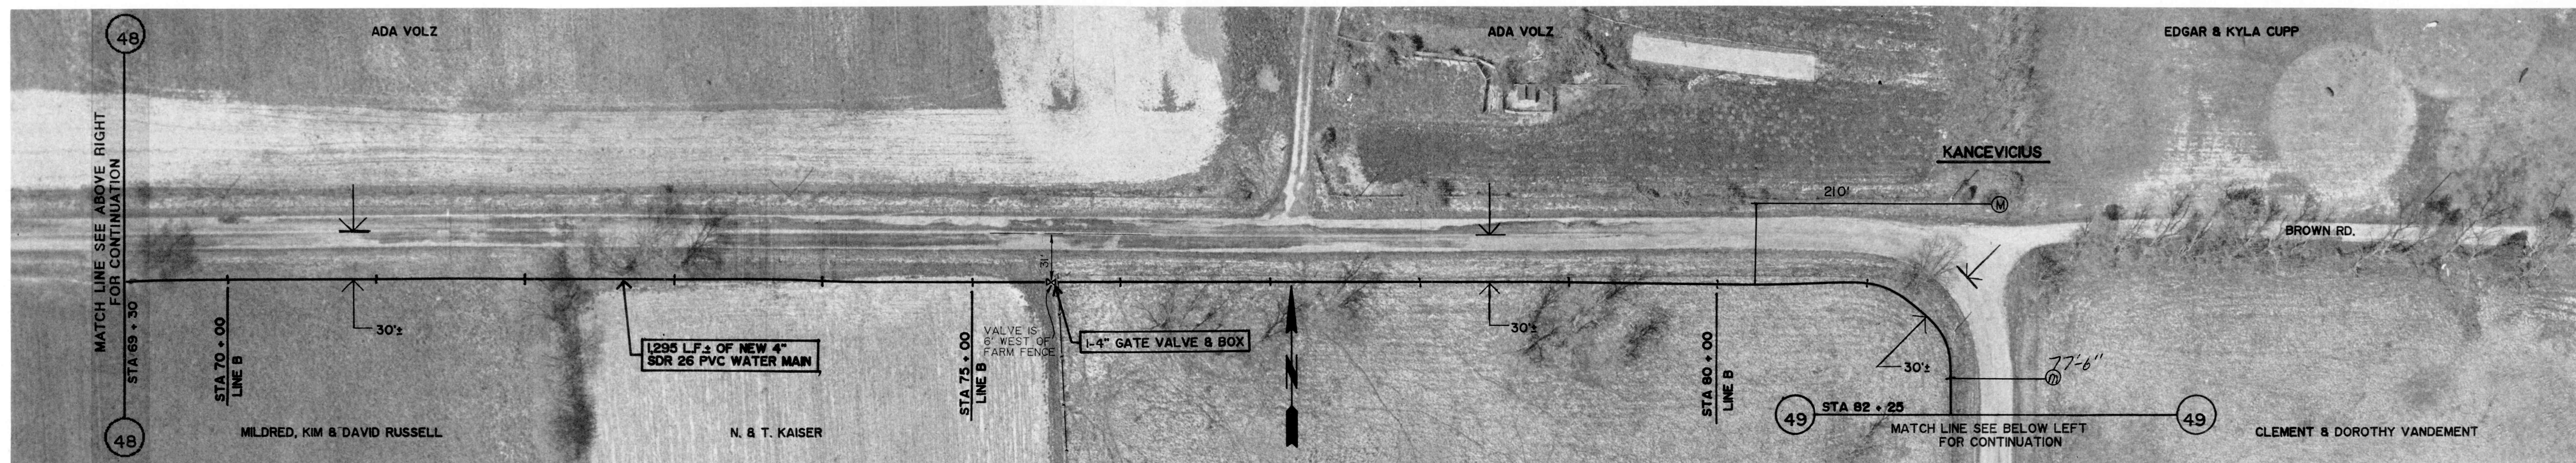

GROUND ELEV. = 1000.0 ±
MAX. STATIC PRESS. = 69.3 PSI ±

WEST COUNTY LINE ROAD

GROUND ELEV. = 982.0 ±
MAX. STATIC PRESS. = 77.1 PSI ±

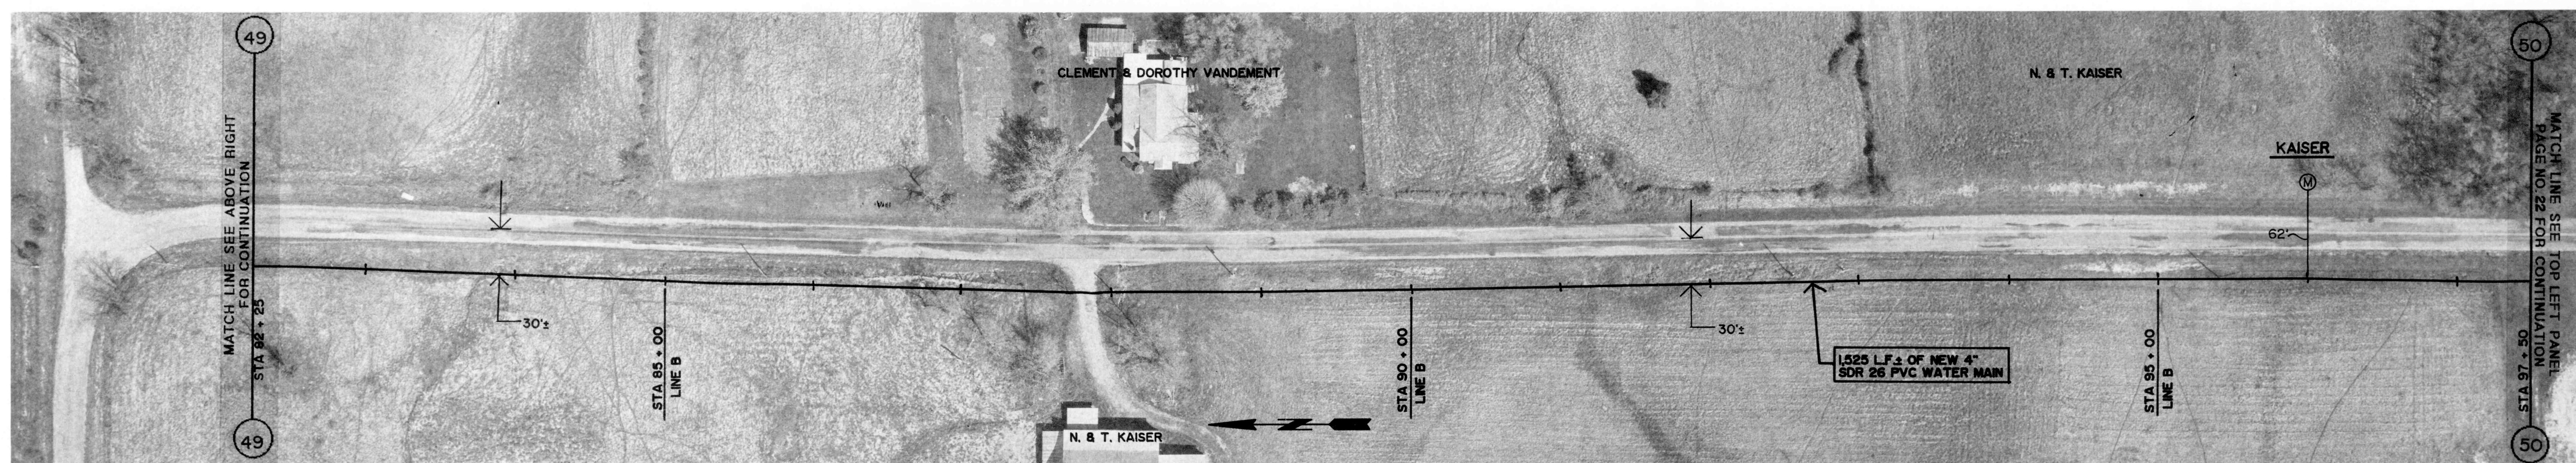

GROUND ELEV. = 982.0 ±
MAX. STATIC PRESS. = 77.1 PSI ±

WEST COUNTY LINE ROAD

GROUND ELEV. = 980.0 ±
MAX. STATIC PRESS. = 77.9 PSI ±

REVISIONS

DRAWN BY: [Signature]
 DATE: 10/1/91
 CERTIFIED BY: REC
 DATE: 10/1/91

ROBERT E. CURRY & ASSOCIATES, INC.
 CONSULTING ENGINEERS

ELROD WATER COMPANY INC.
 DIVISION "D" DISTRIBUTION SYSTEM EXTENSIONS

4" PVC WATER MAIN
 EXTENSION ALONG
 WEST COUNTY LINE ROAD

JOB NO. [Blank]
 SHT. 21
 SCALE 1" = 50'
 OF 43