


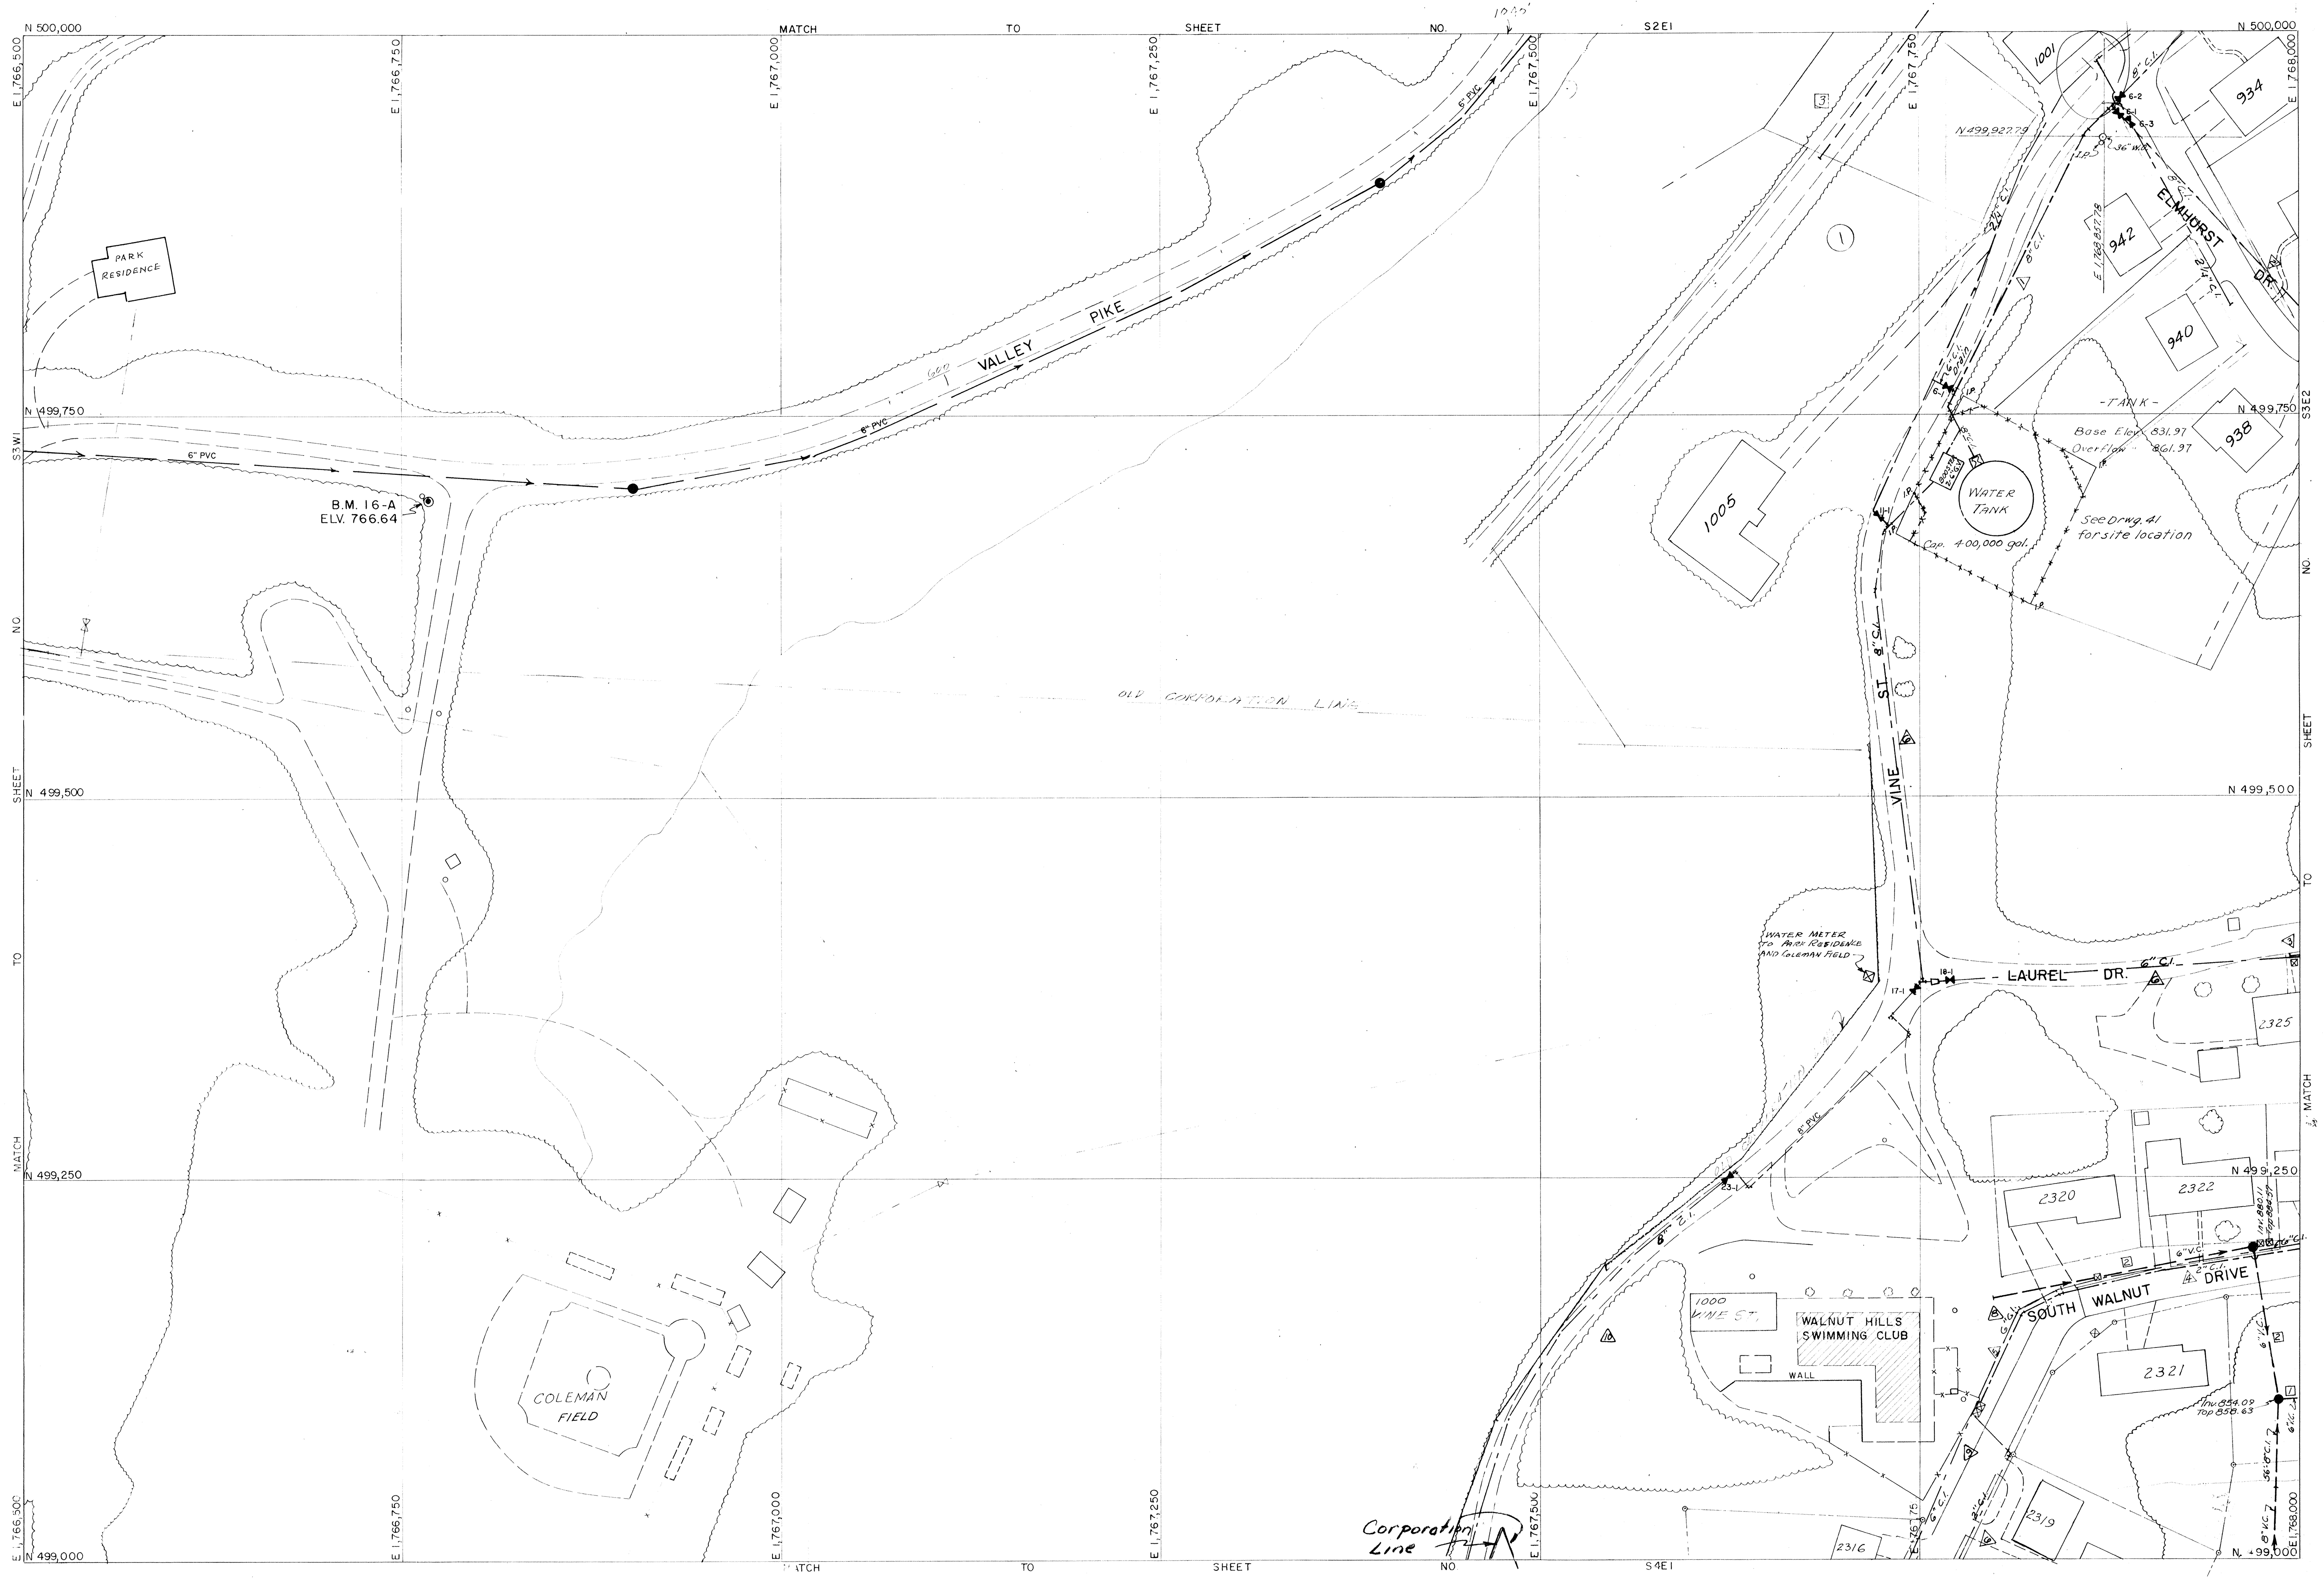

REVISIONS	
WATER LINES	
6" - 18' C.I.	
8" - 505' C.I.	
SEWER LINES	
6" V.C. - 289'	
8" V.C. - 45'	
8" C.I. - 55'	
FIRE HYDRANTS	
● SMALL HYDRANT	
◆ 4" STEAMER	
◇ 4 1/2" STEAMER	
VALVES	
6" - 1	
8" - 3	
MANHOLES SAN.	
MANHOLES S.D.	2
LAMP HOLES	
CATCH BASINS	
METERS	
WATER EXTENSIONS	

- 1. 2+55 Vine St.
- 2. 2+55 Elmhurst Dr.
- 3. 1+270 Laurel Dr.
- 4. 1+277 So. Walnut Dr.
- 5. 1+278 So. Walnut Dr.
- 6. 2+71 Eldot-S. Walnut
- 7. 2+90 South Walnut Dr.
- 8. 2+91 " "
- 9. 2+93 Vine St. & Dry Ridge

- | SEWER EXTENSIONS | |
|-------------------------|--|
| 1. 3+26 So. Walnut Dr. | |
| 2. 3+33 So. Walnut Dr. | |
| 3. 3+109 Sand Hill Park | |

AMERICAN AIR SURVEYS, INC.
PITTSBURGH, PENNA.

CITY OF ST. ALBANS, W. VA.
MUNICIPAL UTILITY COMMISSION
SCALE: 1" = 50'

DATE PLAT PREPARED 11-22-65
WATER SYSTEM ADDED 12-14-65
SANITARY SEWERS ADDED 12-14-65
STORM SEWERS ADDED

PLAT NO.
S3E1